




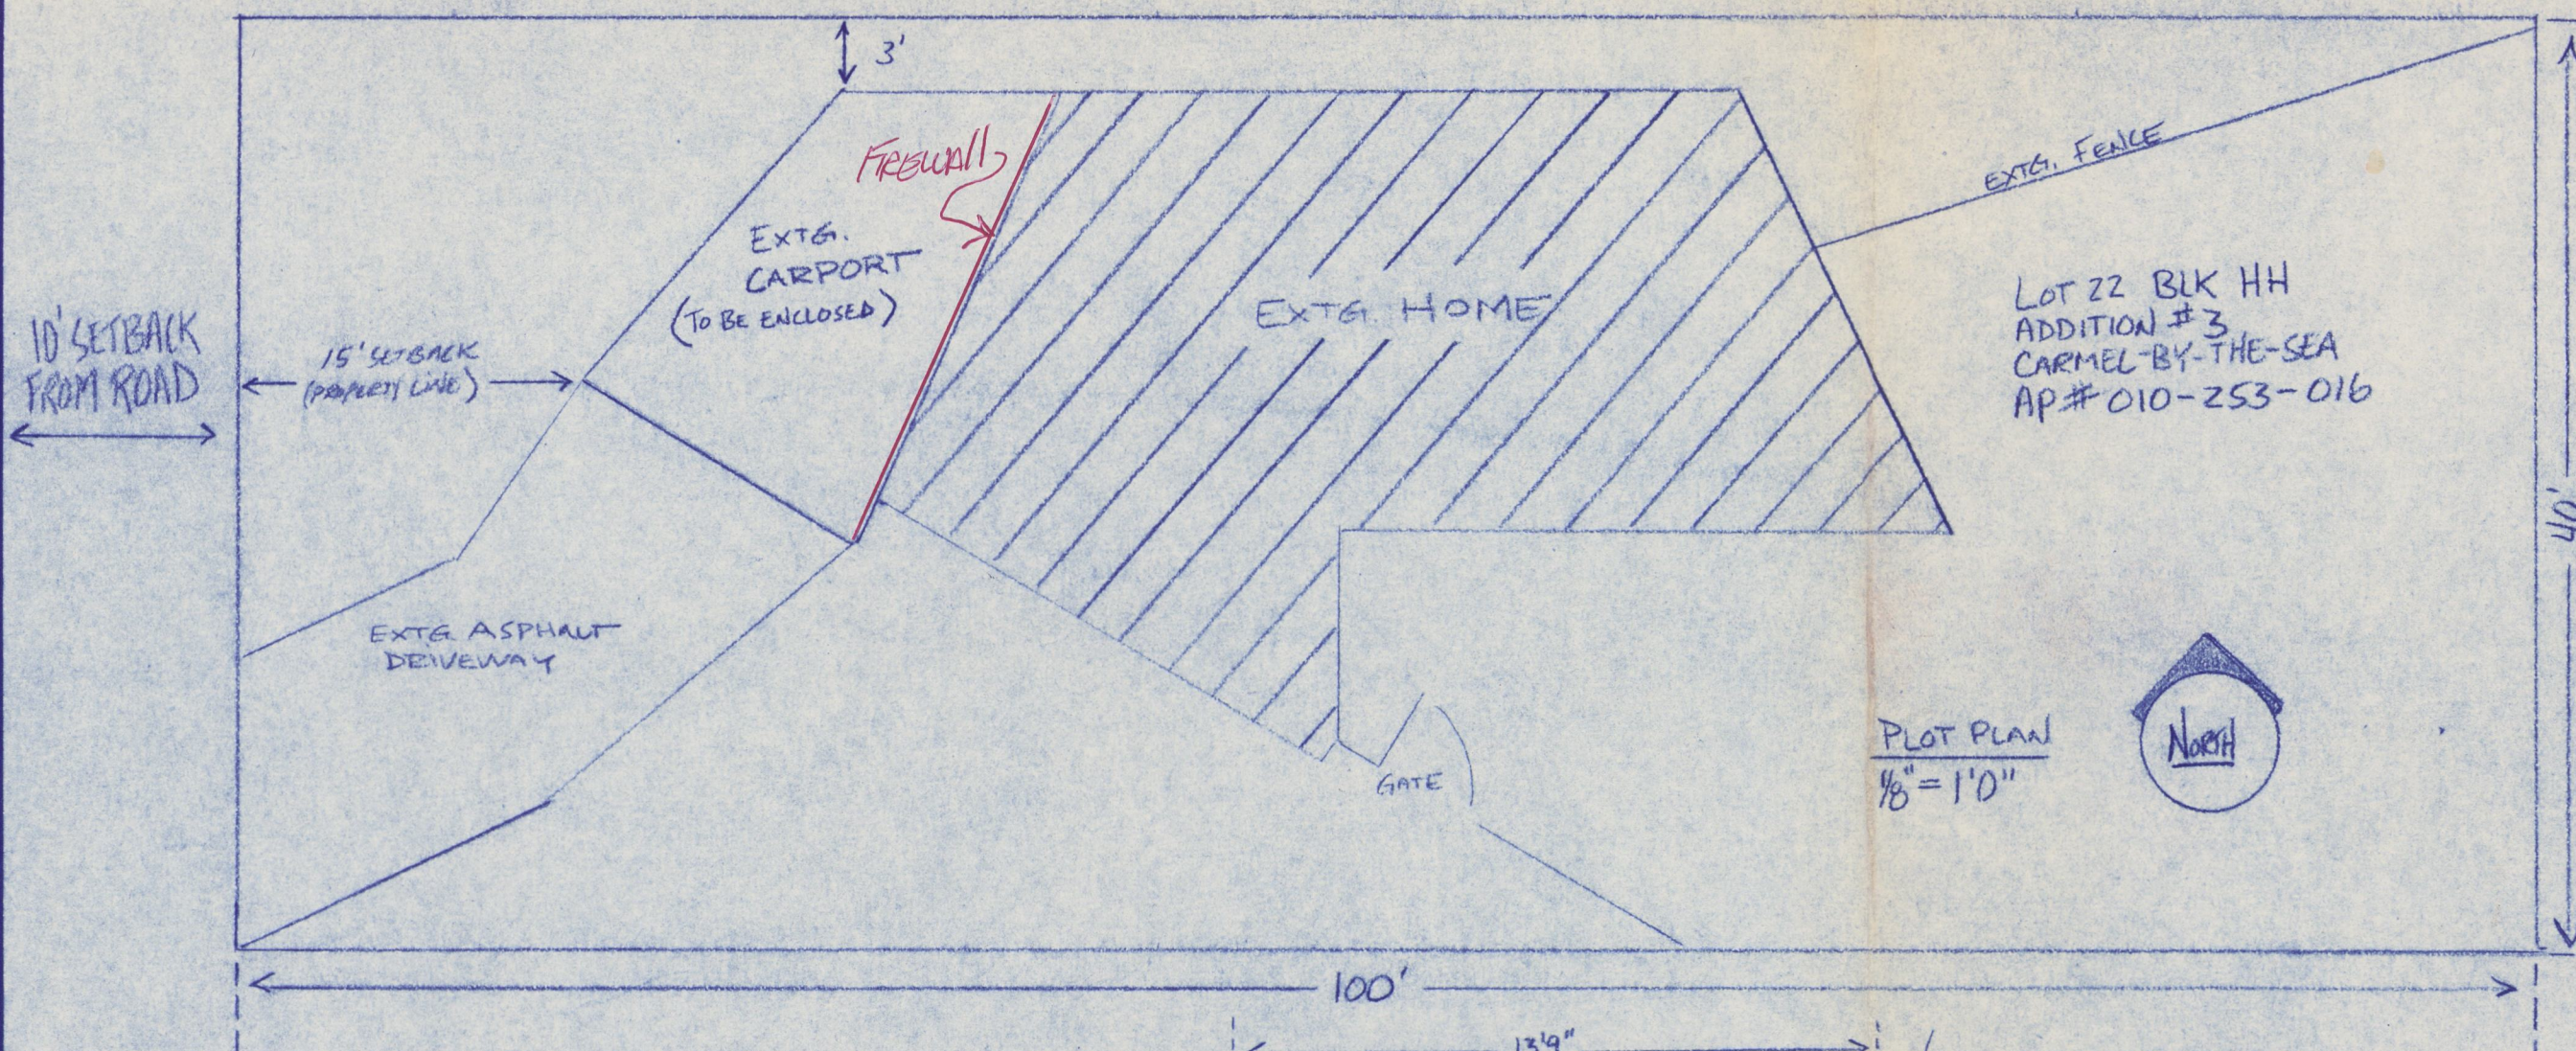


CITY COUNTY ORDINANCE REQUIREMENTS

- 1) The use of solders containing more than two-tenths of one percent lead in making joints on private or public water supply systems is prohibited. (SB164)
- 2) The use of plumbing pipelines as an electrical ground is prohibited. (SB164)
- 3) No potable water may be used for compaction or for dust control purposes in construction activities where there is a reasonably available and appropriate source of reclaimed or sub-potable water approved by the Monterey County Health Department. (ORD. 3522 sect.6k)
- 4) All hoses used in connection with any construction activities shall be equipped with a shut-off nozzle. When an automatic shut-off nozzle can be purchased or otherwise obtained for the size or type of hose in use, the nozzle shall have an automatic shut-off. (ORD. 3522 sect. 6k)
- 5) No person may tap into any fire hydrant for any purpose other than fire suppression or emergency aid, without first obtaining written approval from the water purveyor supplying water to the hydrant and the Monterey County Health Department. (ORD. 3522 sect.6i)
- 6) All toilets shall be ultra-low-flow type, 1.6 gallons ma. per flush; showerheads shall have a maximum flow rate of 2.5 gallons per minute at 40 psi; all hot water pipes shall be insulated and be on a hot water recirculating system; building water pressure shall be limited to 50 psi or less. (ORD. 3522 sect.6Q)

FIRE DEPARTMENT REQUIREMENTS

- 1) **Water supply:** An adequate water supply shall be made available at the site per Monterey County General Plan requirements (Table 2A).
- 2) **Access:** The driveway shall maintain a minimum 12 foot width and 13 foot, 6 inch verticle clearance for access of fire fighting apparatus. The length of a dead end driveway shall be limited to 150 feet unless adequate turn-around space is provided. The maximum grade of the driveway shall not exceed 15% and driveways over 8% in grade shall be composed of a minimum 2" thick asphaltic concrete over a 4 inch base of decomposed granite. All driveways shall be designed and maintained to support the loads of fire fighting apparatus in all weather conditions.
- 3) **Premises identification:** The street address must be clearly posted before any work is to commence.
- 4) **Clearance:** Maintain a fire break around all structures for a distance of 30 feet or to the property line, whichever is less, clear of combustible growth or flammable vegetation, excluding ornamental landscaping.
- 5) **Smoke detectors:** Install smoke detectors on every floor and in every sleeping area.
- 6) **Roofing:** Roof construction of all structures is to consist of Class B or better fire retardant materials.

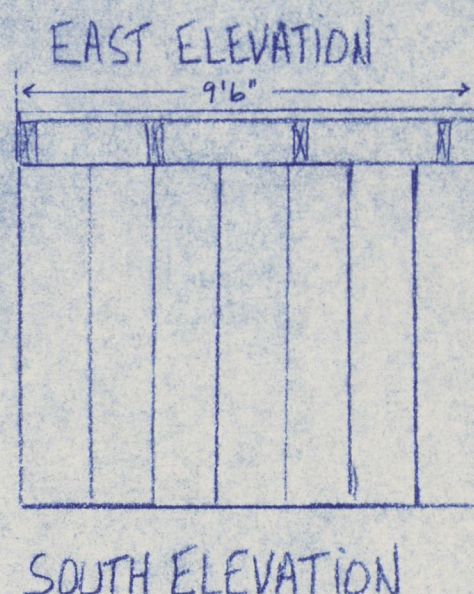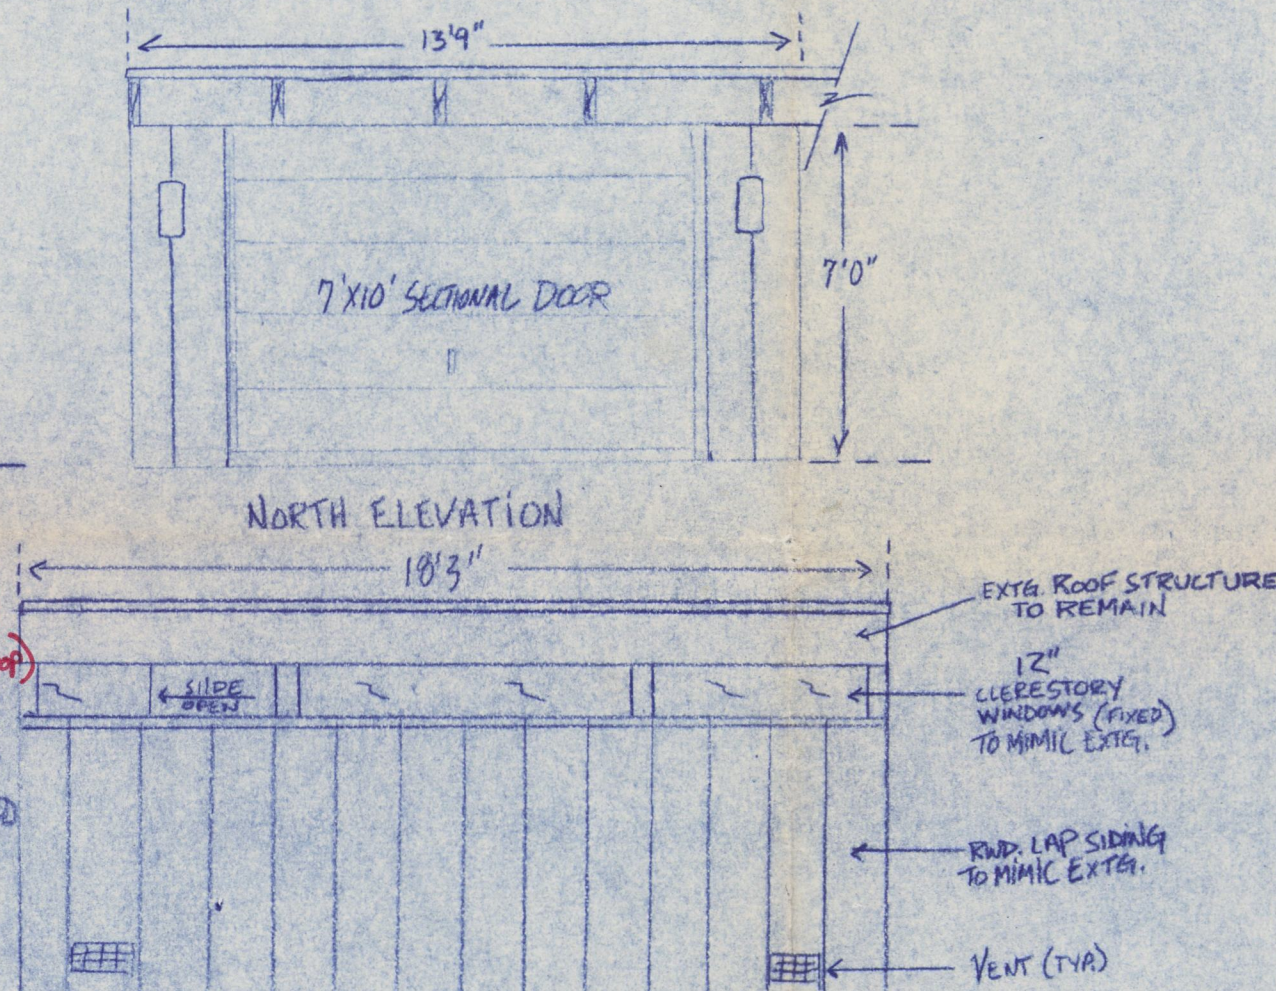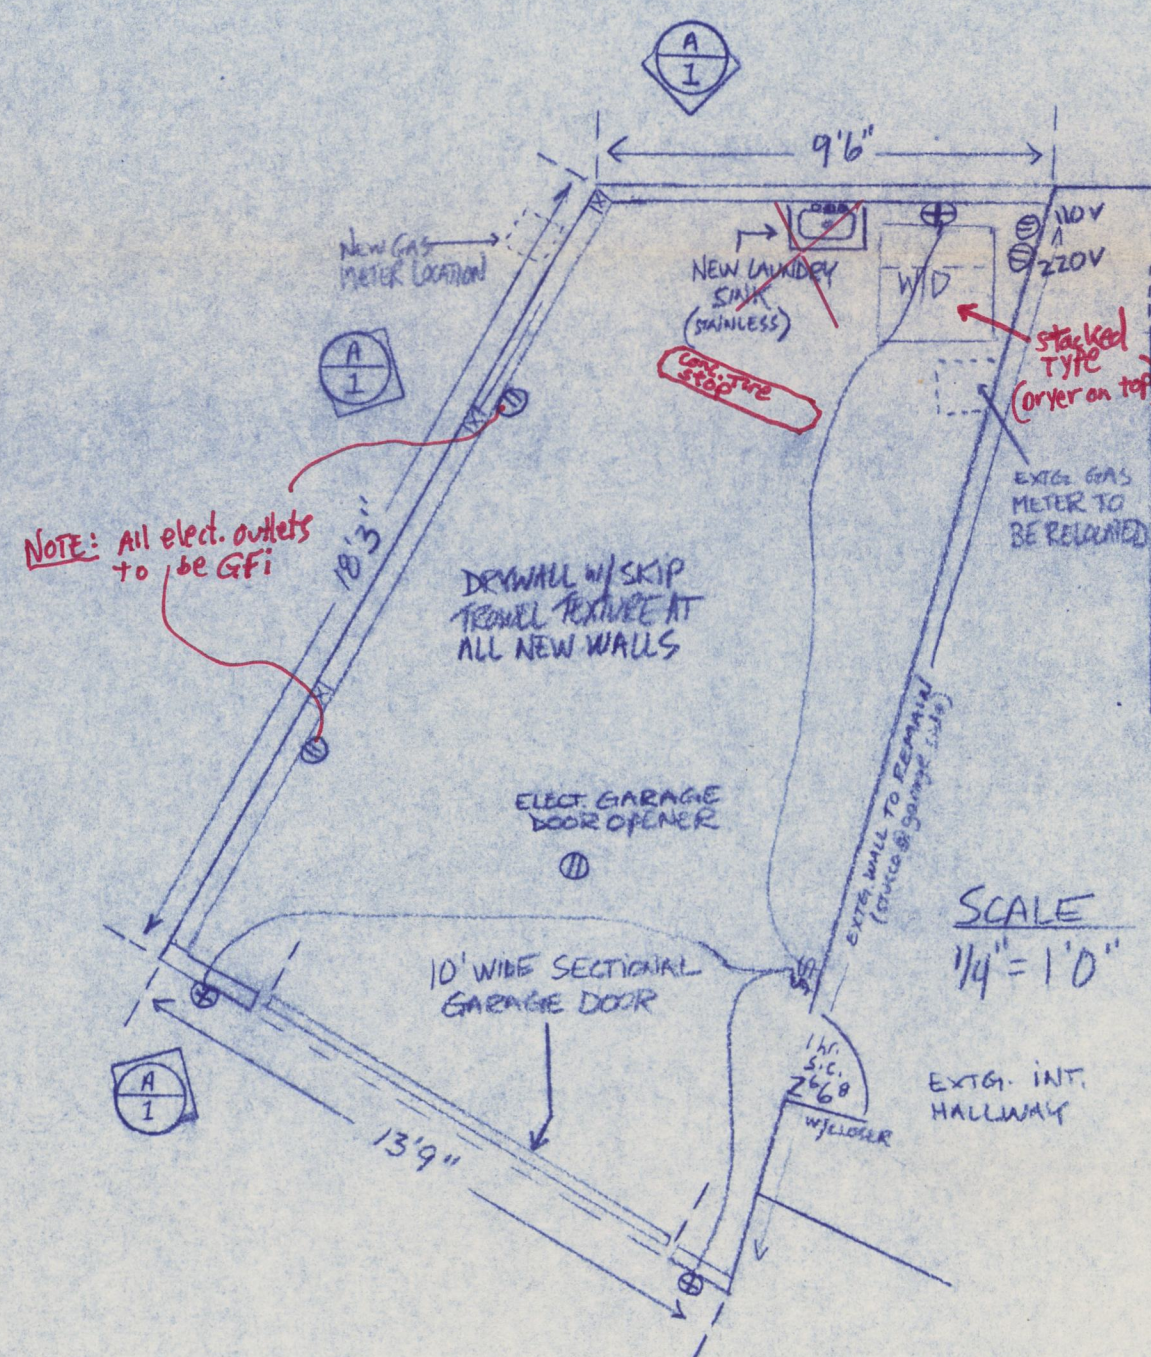

APPROVED PLANS

Date	Department	Approved		
		Yes	No	Comments
	Fire Dept.			
	Forestry Dept.			
	Public Works			
	Building			
	Design			
	Design Rev. Comm.			
	Use Permit			
	Variance			

MONTEREY PENINSULA WATER MANAGEMENT DISTRICT

APPROVED

APPROVED BY *Jabula Chyala*

DATE *9/8/94* PERMIT NUMBER *14368*

FINAL INSPECTION REQUIRED BY MPWMD

NOTICE

Per Carmel Municipal Code Section 12.32.115, disposal, wash-off, or washdown of any and all materials such as mortar, concrete, paint, grease, etc. on public property, including the storm drain system, is strictly prohibited unless specifically and individually approved by the Public Works Director. Violators will be cited and assessed all cleaning costs.

REVISIONS	BY
8-3-94	

CARIBOU CONST. CO.
P.O. BOX 221817
CARMEL, CA 93922
(408) 624-1311

VIRGINIA HAYES (SAN ANTONIO ST. 3RD SE of 4TH AVE.)
P.O. BOX 6204
CARMEL, CA 93921 (408) 625-6712

Date	7-22-94
Scale	
Drawn	<i>[Signature]</i>
Job	CARPORT TO GARAGE
Sheet	1
Of 1	Sheets

10-253-16

